

Controlled on: superior trainer system 11i

Griffith - West Sarnia

From Line 6A (East Superior - Griffith)

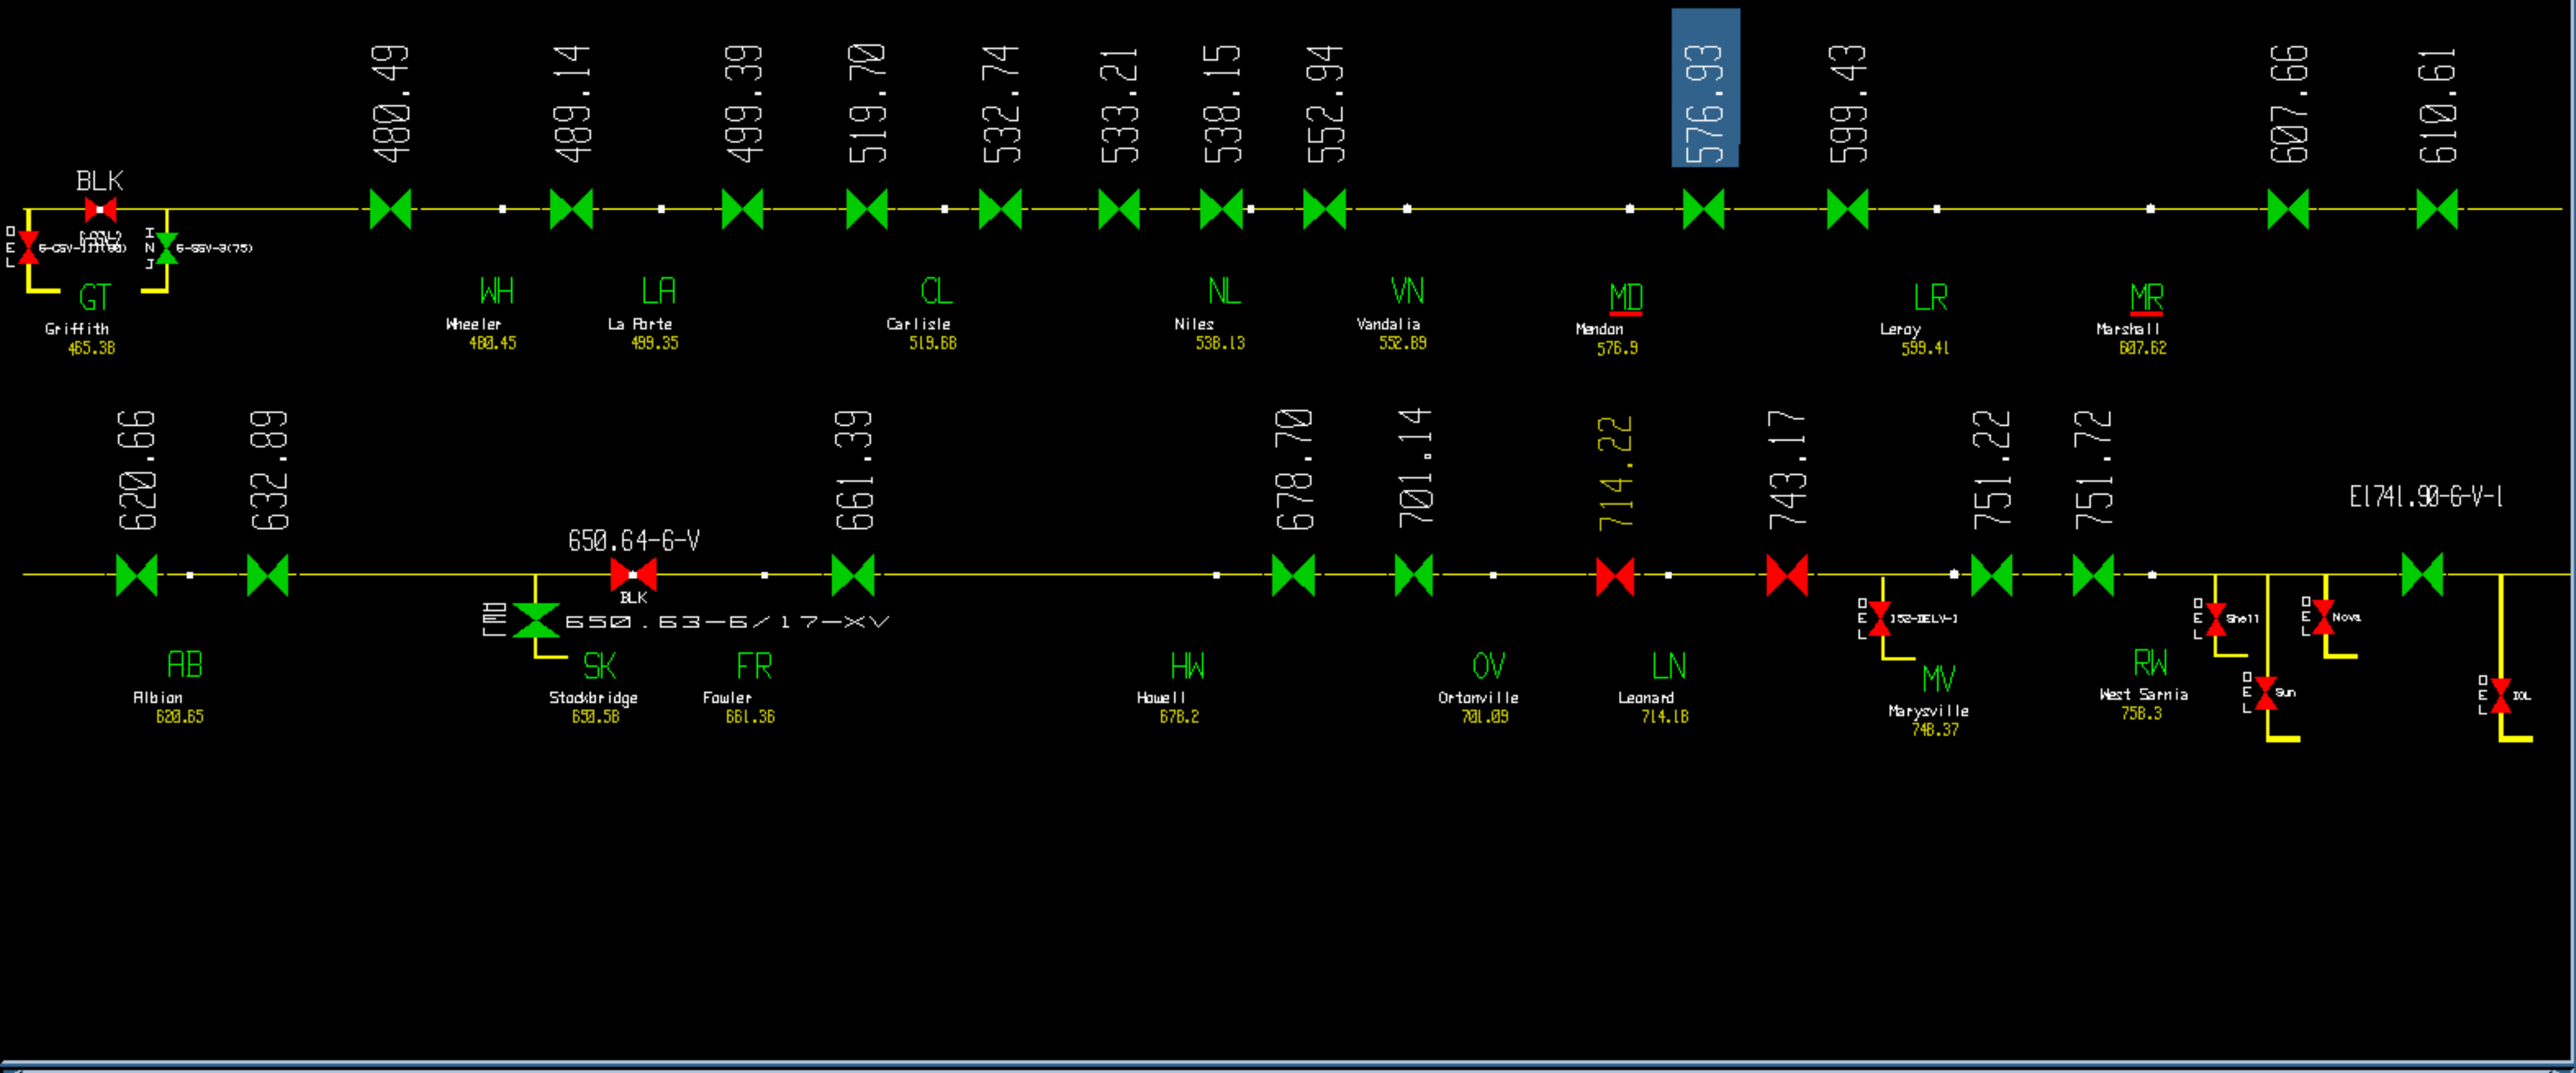


Figure 9: Simulated Line 6B Valve Display From Griffith to West Sarnia Feb. 1, 2012 Source: Enbridge Energy (NTSB: IR-351).