

Docket No. SA-534


Exhibit No. 2-M

NATIONAL TRANSPORTATION SAFETY BOARD

Washington, D.C.

PRESSURE TRANSDUCER LOCATIONS ALONG
LINES 101, 109, AND 132

(3 Pages)

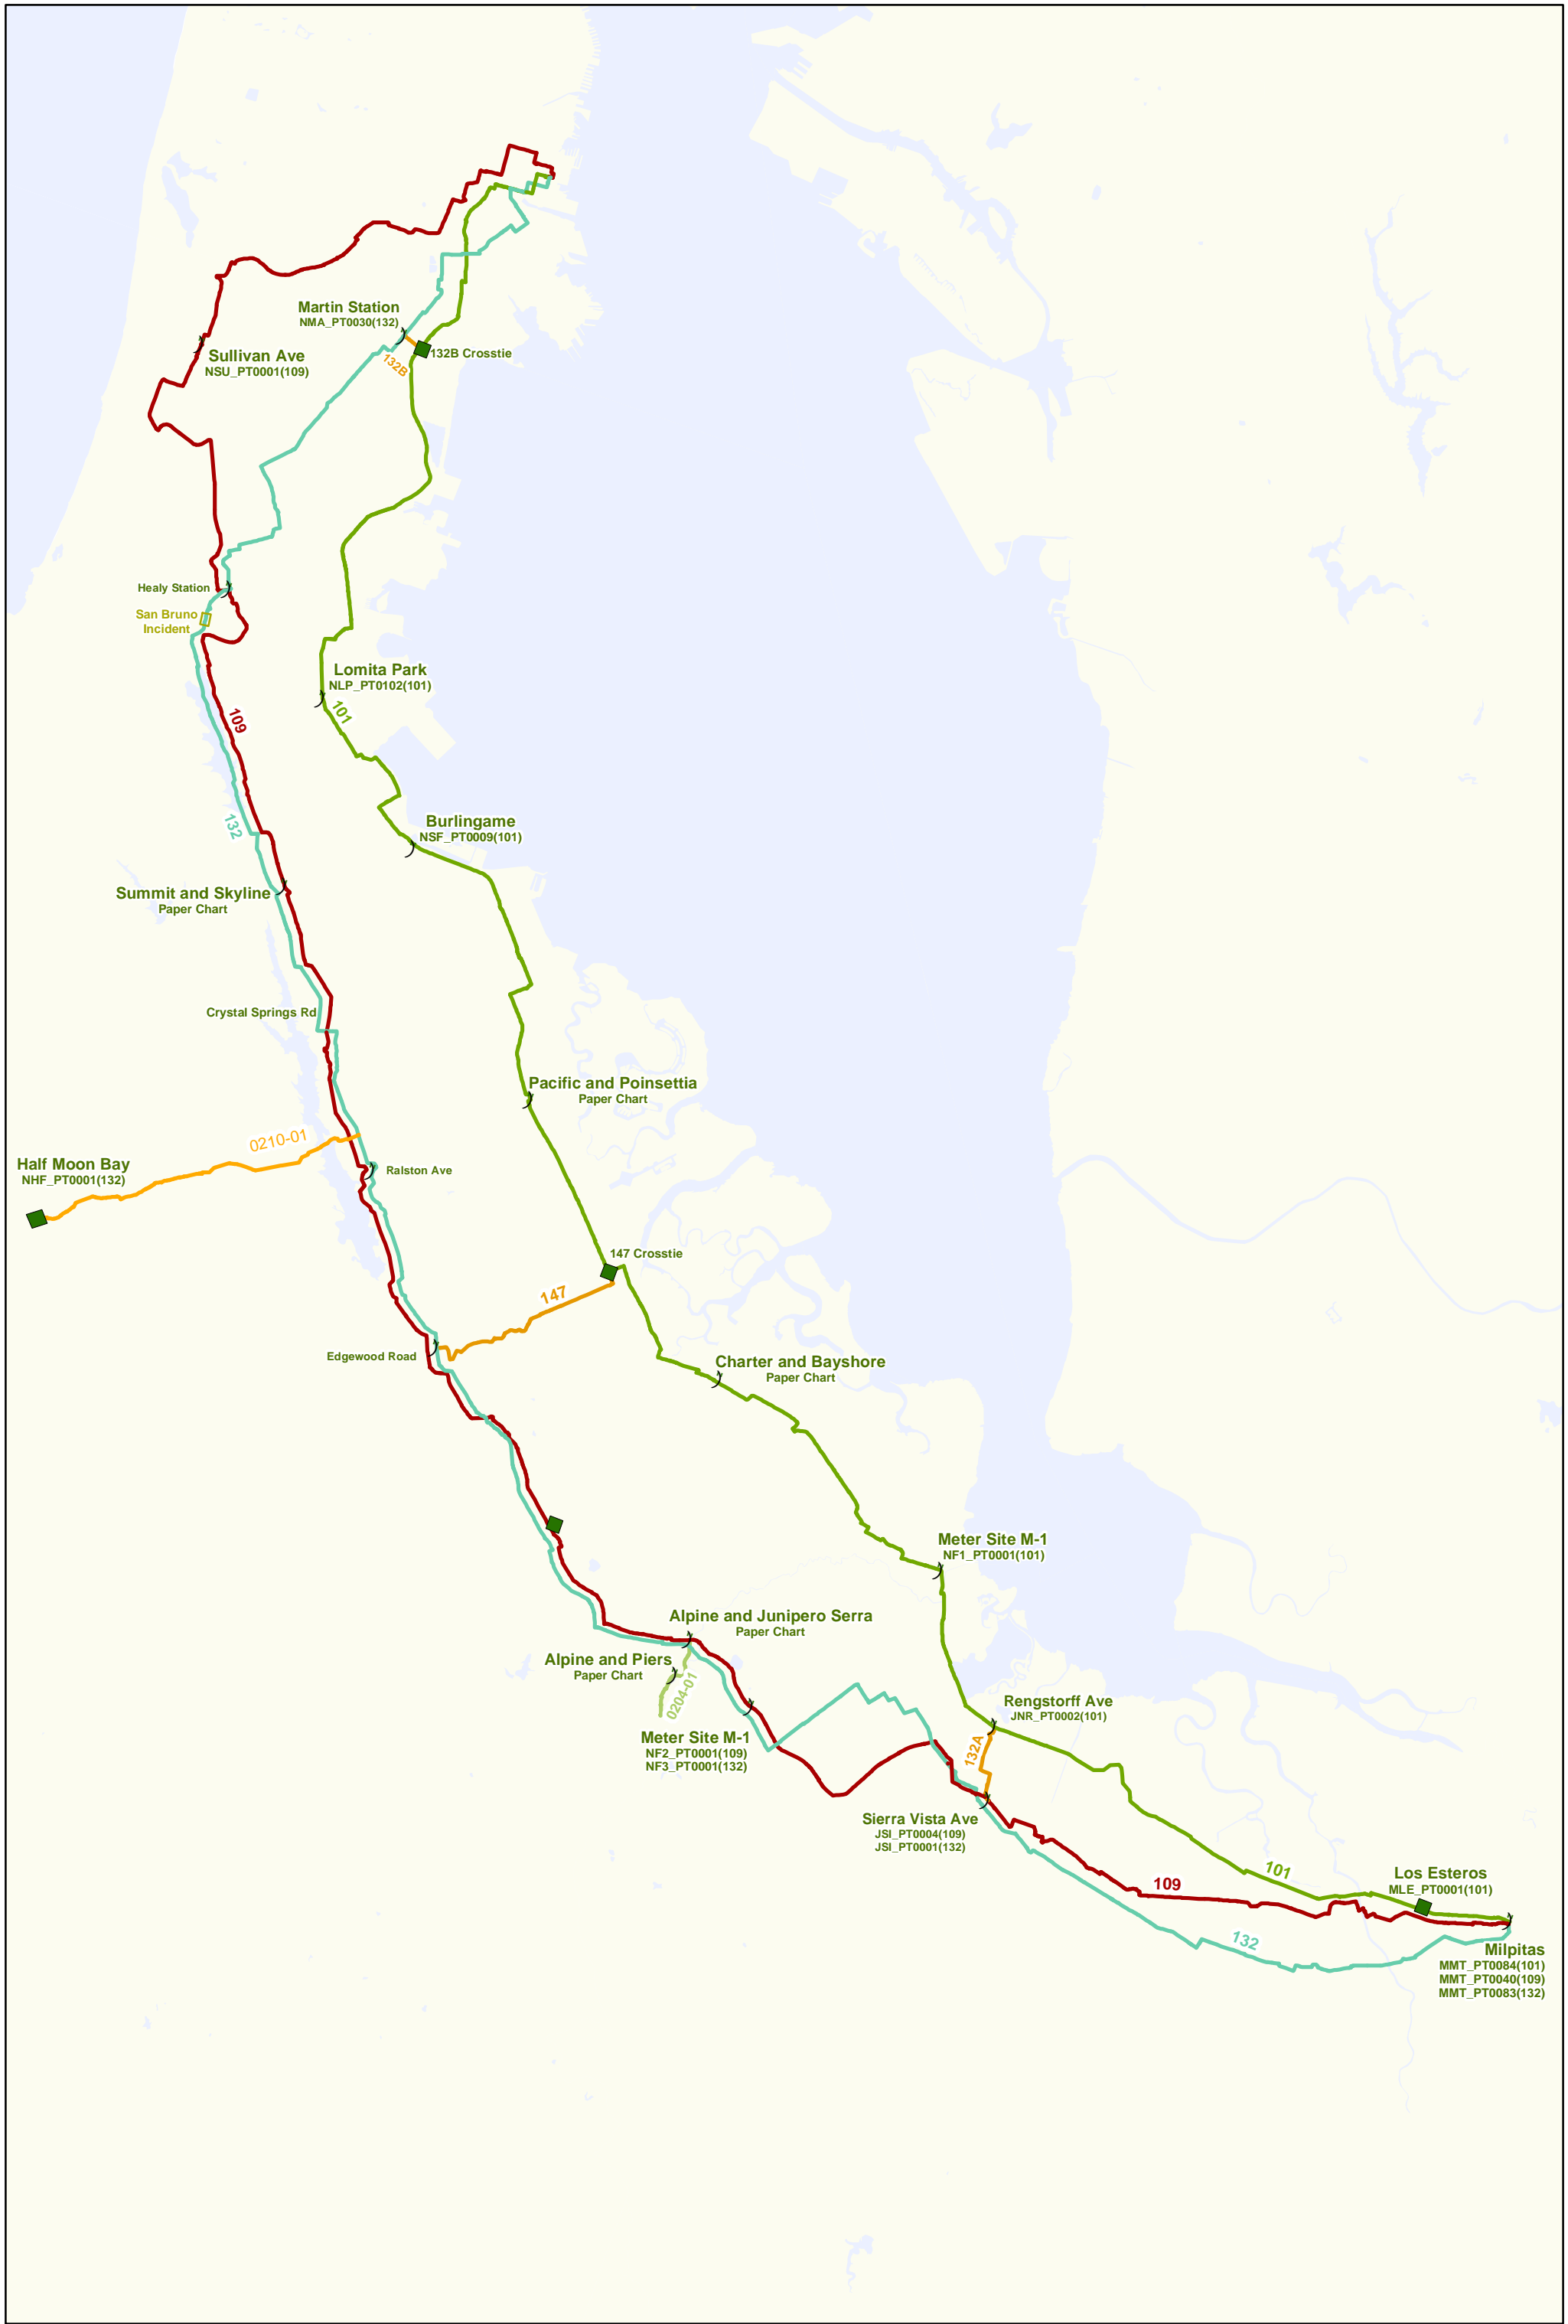

Schematic of Pressure Points LT System

Data Response NTSB 036-004

- 101
- 109
- 132
- 132A
- 132B
- 147
- 0210-01

PACIFIC GAS AND ELECTRIC COMPANY
San Bruno Gas Transmission Line Incident
Data Response

PG&E Data Request No.:	NTSB_049-001		
PG&E File Name:	San Bruno GT Line Incident_DR_NTSB_049-001		
Request Date:	February 4, 2011	Requesting Party:	NTSB
Date Sent:	February 4, 2011	Requestor:	Operations (Chhatre)

QUESTION 1

NTSB requests the following documents be reviewed to determine whether PG&E would agree to not assert a claim of privilege.

- NTSB_008-004
- NTSB_008-004S1
- NTSB_011-008
- NTSB_004-004
- NTSB_004-001
- NTSB_014-006
- NTSB_036-004
- PIR print with overlay entitled "PIR between line 132 mlv 38.49 to MLV 40.05"
- NTSB_001-011
- NTSB_035-12
- NTSB_008-003

ANSWER 1

PG&E did not assert, or has agreed not to assert a claim of privilege for the following documents:

- NTSB_008-004
- NTSB_011-008 (Names Redacted)
- NTSB_004-004
- NTSB_004-001 (Amended)
- NTSB_014-006 (Name Redacted)
- **NTSB_036-004**
- PIR print with overlay entitled "PIR between line 132 mlv 38.49 to MLV 40.05" (NTSB_016-003)
- NTSB_001-011

**PACIFIC GAS AND ELECTRIC COMPANY
San Bruno Gas Transmission Line Incident
Data Response**

- NTSB_035-12
- NTSB_008-003

With respect to NTSB_008-004S1, PG&E is waiting for a response from NTSB in order to make a determination.