

Docket No. SA-534

Exhibit No. 2-X


NATIONAL TRANSPORTATION SAFETY BOARD

Washington, D.C.

NTSB_008-003
HEALY STATION ONE-LINE DIAGRAM
WITH CROSS TIE VALVES

(5 Pages)

SAN FRANCISCO DIVISION
SAN FRANCISCO COUNTY
SAN MATEO COUNTY
PENINSULA DIVISION

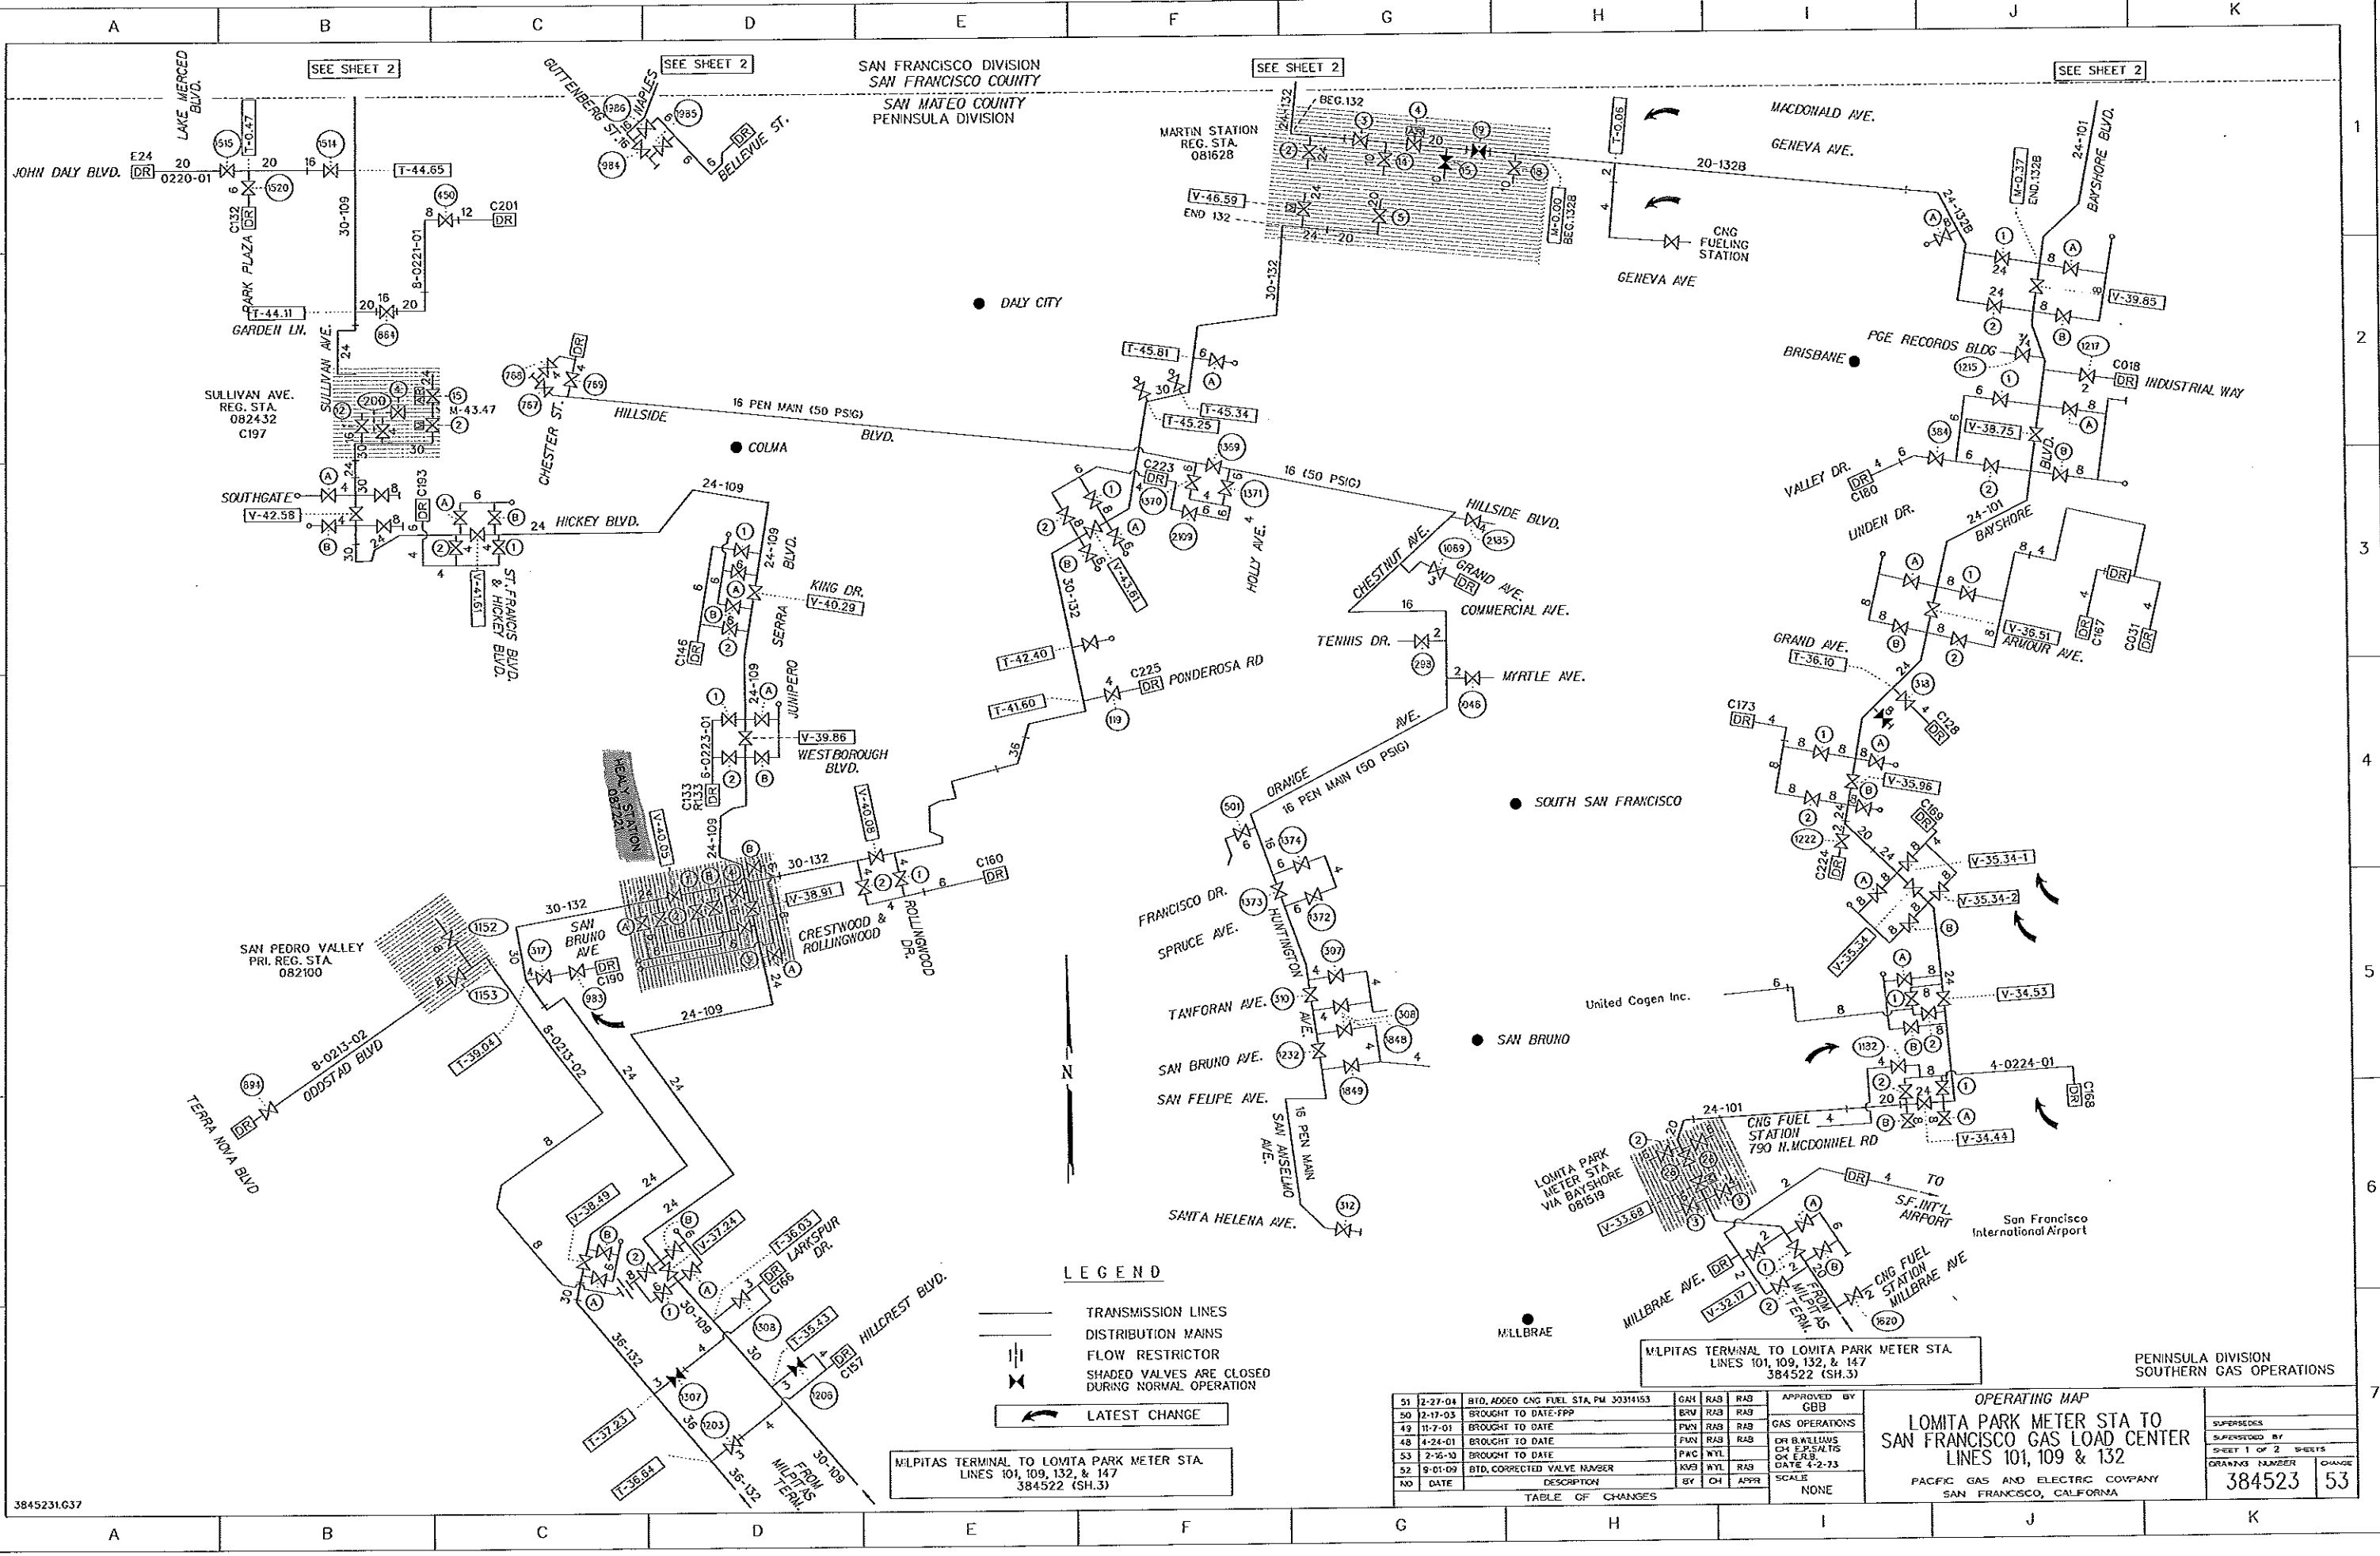

- LEGEND**
- TRANSMISSION LINES
 - DISTRIBUTION MAINS
 - FLOW RESTRICTOR
 - SHADED VALVES ARE CLOSED DURING NORMAL OPERATION
 - LATEST CHANGE

MILPITAS TERMINAL TO LOMITA PARK METER STA.
LINES 101, 109, 132, & 147
384522 (SH.3)

NO	DATE	DESCRIPTION	BY	CHK	APPR
51	2-27-04	BID, ADDED CNG FUEL STA. PM 30314153	GAH	RAB	RAB
50	2-17-03	BROUGHT TO DATE-FPP	BRV	RAB	RAB
49	11-7-01	BROUGHT TO DATE	PLN	RAB	RAB
48	4-24-01	BROUGHT TO DATE	FLN	RAB	RAB
53	7-15-13	BROUGHT TO DATE	PAC	WYL	RAB
52	9-01-09	BID, CORRECTED VALVE HANDB	KVB	WYL	RAB

OPERATING MAP
LOMITA PARK METER STA TO
SAN FRANCISCO GAS LOAD CENTER
LINES 101, 109 & 132

PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

384523 53

LOMITA PARK METER STATION TO
SAN FRANCISCO GAS LOAD CENTER
LINES 101, 109 & 132
384523 SH 1

LOMITA PARK METER STATION TO
SAN FRANCISCO GAS LOAD CENTER
LINES 101, 109 & 132
384523 SH 1

LEGEND

- TRANSMISSION LINES
- DISTRIBUTION MAINS
- ☒ SHADED VALVES ARE CLOSED DURING NORMAL OPERATION
- ↶ LATEST CHANGE

NO	DATE	DESCRIPTION	BY	CHK	APPR
52	2-16-10	BROUGHT TO DATE	PAC	WYL	
48	11-13-04	BROUGHT TO DATE	DNS	RAB	RAB
47	7-7-04	BROUGHT TO DATE, ASAND REG STA A21	WYL	RAB	RAB
51	7-25-08	BTD, ASAND DREG & 4" MAIN, NO+487358-84	SWS	RAB	RAB
50	2-10-05	BROUGHT TO DATE PW +30466347-06	UCV	RAB	RAB
49	10-19-03	BROUGHT TO DATE	UCV	RAB	RAB
NO	DATE	DESCRIPTION	BY	CHK	APPR


TABLE OF CHANGES

APPROVED BY		GAS OPERATIONS	
DR PT / AS	CH PT	OK	DATE 7-28-65
SCALE		NONE	

OPERATING MAP
MILPITAS TERMINAL TO
LOMITA PARK METER STATION
LINES 101, 109, 132 & 147
PENINSULA DIVISION
SOUTHERN GAS OPERATIONS

NEXT VALVE NO.	384522
SUPERSEDES	382706
SHEET NO. 3 OF 3	384522
DRAWING NUMBER	52

3845223.637

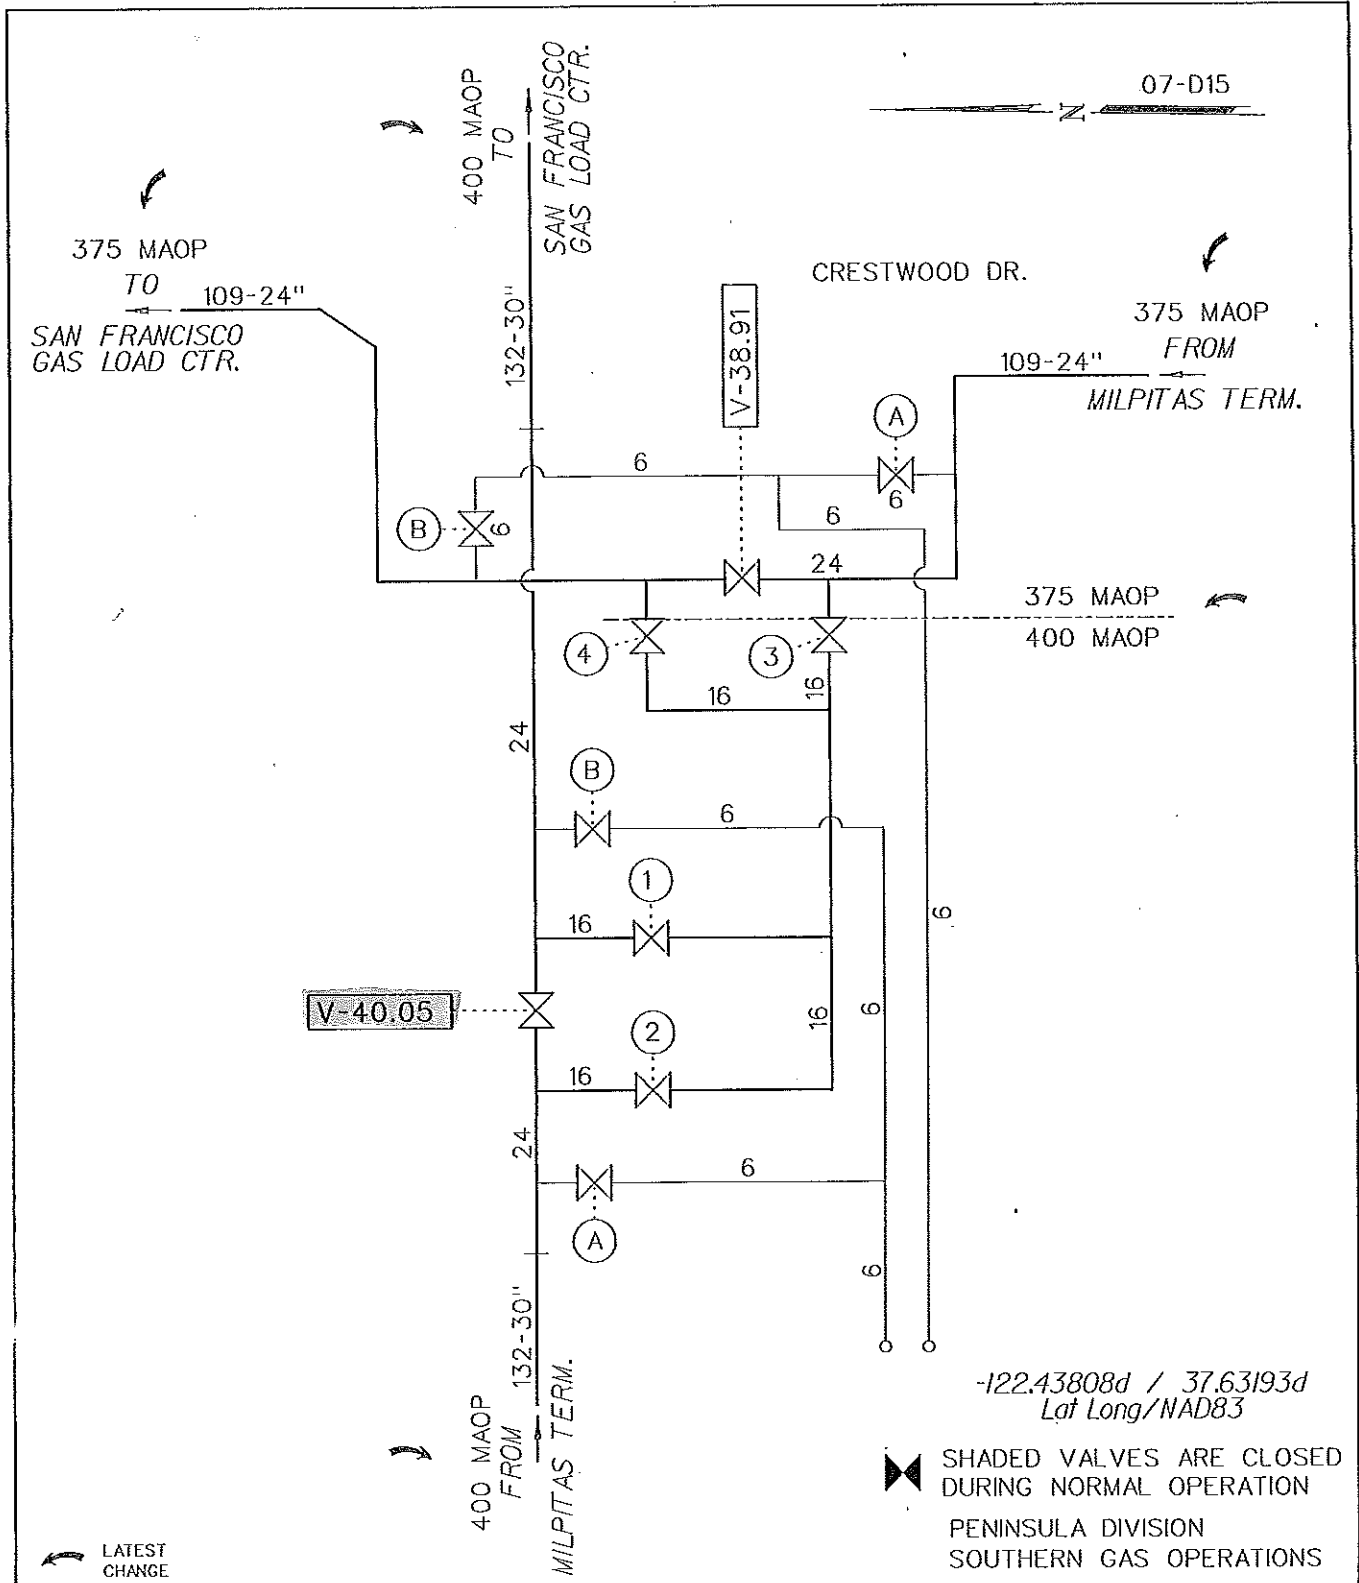

LATEST CHANGE

SHADED VALVES ARE CLOSED DURING NORMAL OPERATION

PENINSULA DIVISION
SOUTHERN GAS OPERATIONS

-122.43808d / 37.63193d
Lat Long/NAD83

APPROVED BY		2 03-07-09		BTD-CHANGED MAOP		DMB	RAB			
		1 8-16-95		ISSUED		RLP	RAB	RAB		
CADD	087221.G06	REV	DATE	DESCRIPTION				BY	CHKD	APVD
DEPT.	GAS OPER	<p align="center">OPERATING DIAGRAM HEALY STATION L109/L132 CROSSTIE CRESTWOOD DR., SAN BRUNO PACIFIC GAS AND ELECTRIC COMPANY SAN FRANCISCO CAL.</p>						NEXT VALVE NO. 5,C		
SUPV.	C. WARNER							SUPSDS		
DWN.	RLP							SUPSD.BY		
CHKD.	RAB							OM	384523	SH.1
O.K.	C.WARNER							DRAWING NUMBER		REV.
DATE	SCALE	087221		2						
8-16-95	NONE									

PACIFIC GAS AND ELECTRIC COMPANY
San Bruno Gas Transmission Line Incident
Data Response

PG&E Data Request No.:	NTSB_049-001		
PG&E File Name:	San Bruno GT Line Incident_DR_NTSB_049-001		
Request Date:	February 4, 2011	Requesting Party:	NTSB
Date Sent:	February 4, 2011	Requestor:	Operations (Chhatre)

QUESTION 1

NTSB requests the following documents be reviewed to determine whether PG&E would agree to not assert a claim of privilege.

- NTSB_008-004
- NTSB_008-004S1
- NTSB_011-008
- NTSB_004-004
- NTSB_004-001
- NTSB_014-006
- NTSB_036-004
- PIR print with overlay entitled "PIR between line 132 mlv 38.49 to MLV 40.05"
- NTSB_001-011
- NTSB_035-12
- NTSB_008-003

ANSWER 1

PG&E did not assert, or has agreed not to assert a claim of privilege for the following documents:

- NTSB_008-004
- NTSB_011-008 (Names Redacted)
- NTSB_004-004
- NTSB_004-001 (Amended)
- NTSB_014-006 (Name Redacted)
- NTSB_036-004
- PIR print with overlay entitled "PIR between line 132 mlv 38.49 to MLV 40.05" (NTSB_016-003)
- NTSB_001-011

**PACIFIC GAS AND ELECTRIC COMPANY
San Bruno Gas Transmission Line Incident
Data Response**

- NTSB_035-12
- NTSB_008-003

With respect to NTSB_008-004S1, PG&E is waiting for a response from NTSB in order to make a determination.