


### 6.1.3. Required Marking Areas and Marking Frequency

#### 6.1.3.1 Excavations occurring within (a) 50 feet of the centerline of a Company pipeline(s)

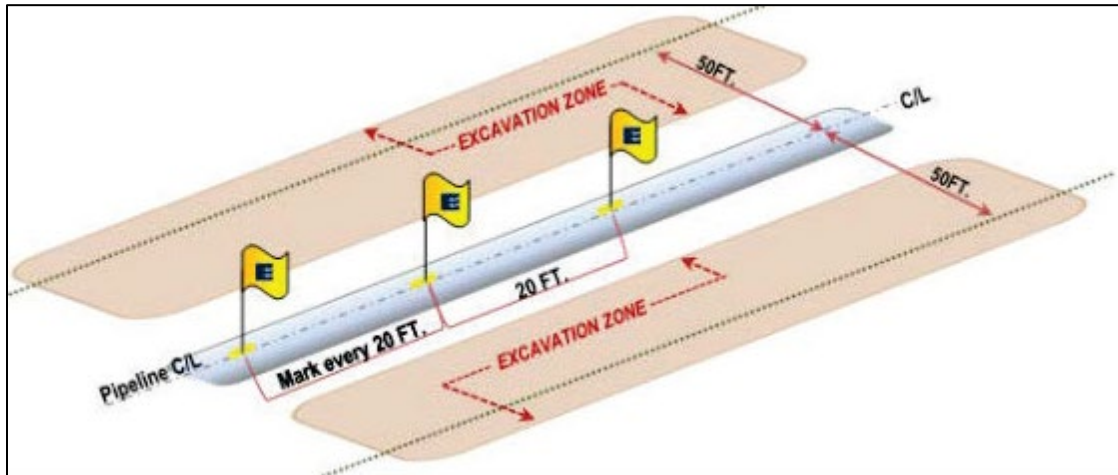

#### 6.1.3.3 Courtesy Markings

In situations where the planned excavation is greater than 50 feet from the centerline of a Company pipeline(s) and is not on a Company ROW, the Line Locator may perform a courtesy locate, if he/she believes the circumstances surrounding the planned excavation could pose a risk to Company pipelines. The distance between any two courtesy markings shall not exceed 200 feet.

